


Electro circuit diagram WTS-200 G1

DANGER:

The assignment of the relays and the digital inputs to the various functions can be freely set in the A parameters.

The assignment shown here corresponds to the factory setting and can be changed as required!

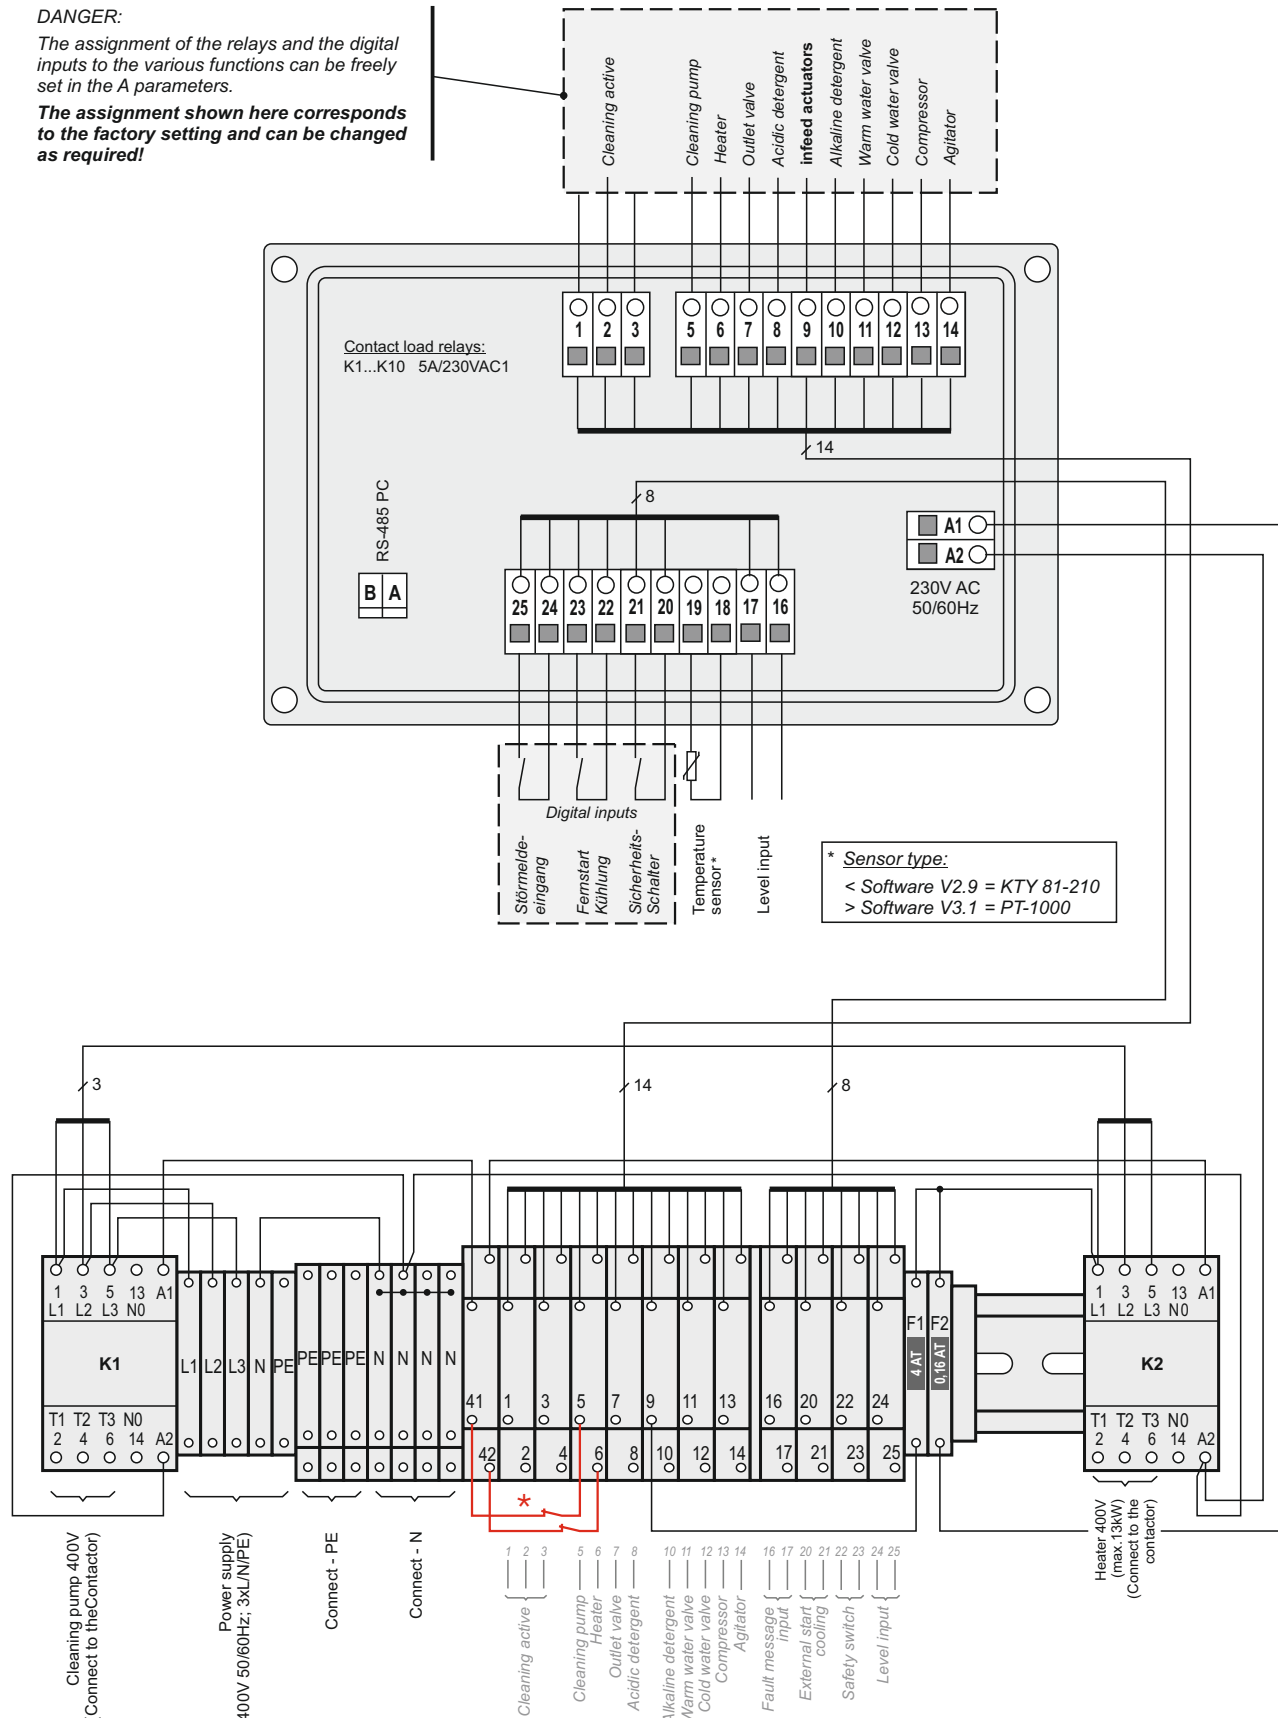

*** CAUTION:**
 Connect the safety chain
 to terminals 5/41 and 6/42!

The numbering of the contacts corresponds
 the terminal numbering of the WTS-200.

106460-E

Electro circuit diagram
 WTS-100-2 G1

Valid from 16.08.2023



WELBA GmbH
 Gewerbepark Siebenmorgen 6
 D-53 547 Breitscheid