


DANGER:

The assignment of the relays and the digital inputs to the various functions can be freely set in the A parameters.

The assignment shown here corresponds to the factory setting and can be changed as required!

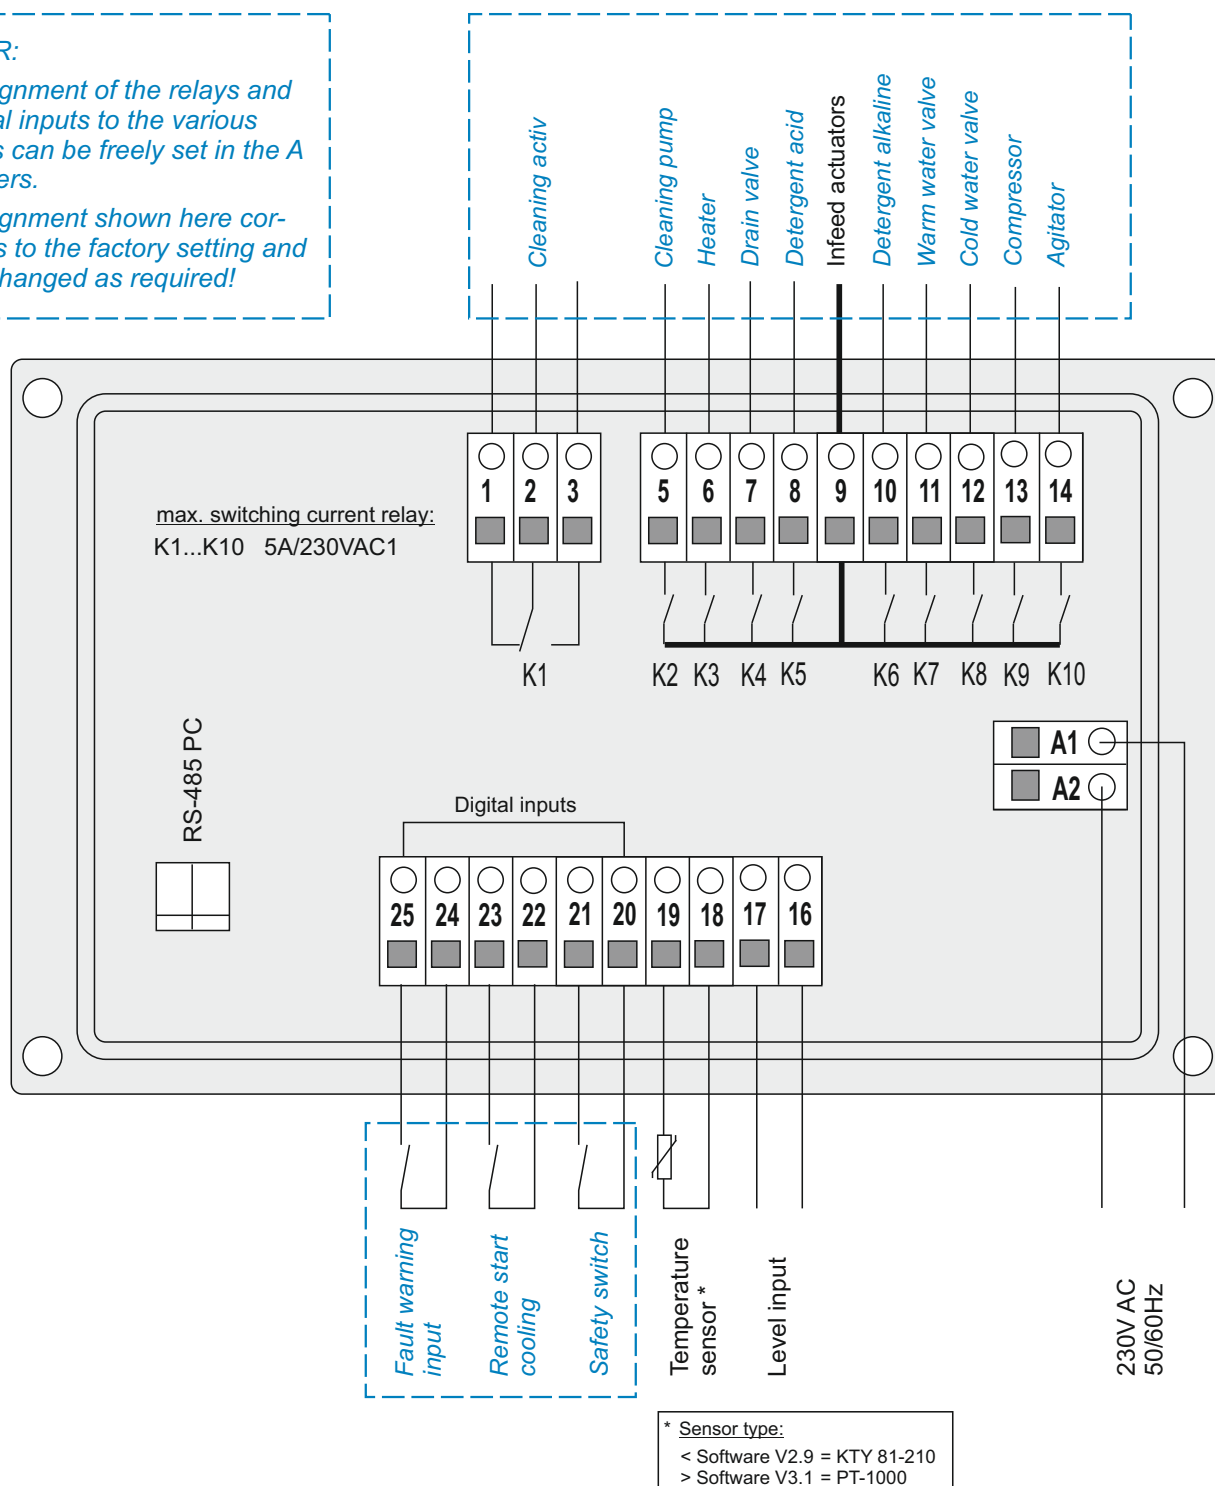

Electro circuit diagram WTS-200

Valid from 16.08.2023



WELBA GmbH
Gewerbepark Siebenmorgen 6
D-53 547 Breitscheid